



## Product Alert

August 16<sup>th</sup>, 2016

### **Type of Notification: Counterfeit**

FM Approvals has been notified of the existence of suspect counterfeit angle hose valves and pressure reducing valves in Colombia. FM Approvals has neither tested nor certified these products.

**Company Identity:** MANGFIRE

**Product Identity:** Unknown

**Description:** 1 ½ in. Pressure Reducing Valve & 2 ½ in. Angle Hose Valve

**FM Approval Status:** Not FM Approved.


**Hazard Involved:** The suspect counterfeit products described in this product alert have never been tested or certified as FM Approved. There is no evidence these suspect counterfeit products have ever been tested to the rigorous requirements of FM Approvals. Use of these products may present a serious property risk for the user.

If you suspect you are in possession of any of the affected equipment listed above bearing the FM Approvals certification marking, please bring that to the attention of:

**Antonio L. Pires**  
**FM Approvals, Quality Department**  
**Norwood, MA, USA**  
**+1 (1)781 255 4825**  
**Email: [Antonio.pires@fmapprovals.com](mailto:Antonio.pires@fmapprovals.com)**



**Figure 1 – Suspected Counterfeit Pressure Reducing Valves**

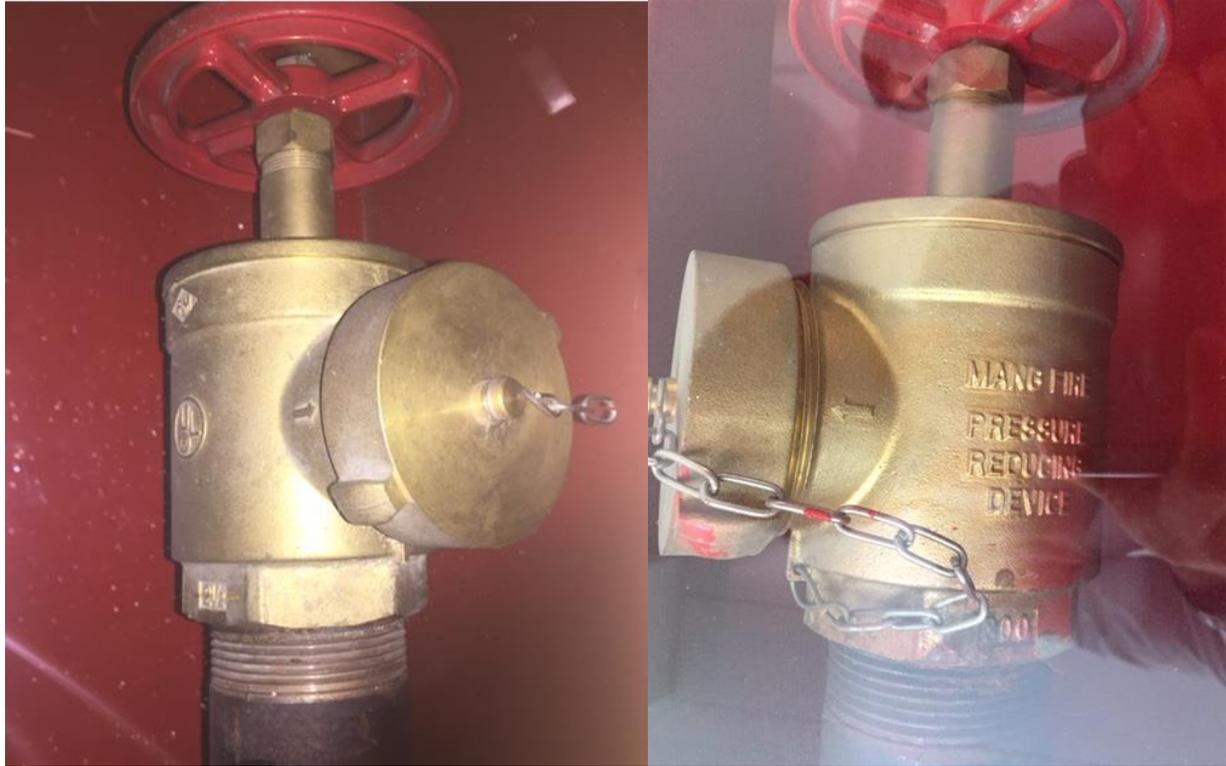

**Figure 2 – Suspected Counterfeit Angle Hose Valve**